


# RACETRACK®

## Route 842 2+2 Wiring Diagram

Copyright © 1999 RACETRACK, Inc.

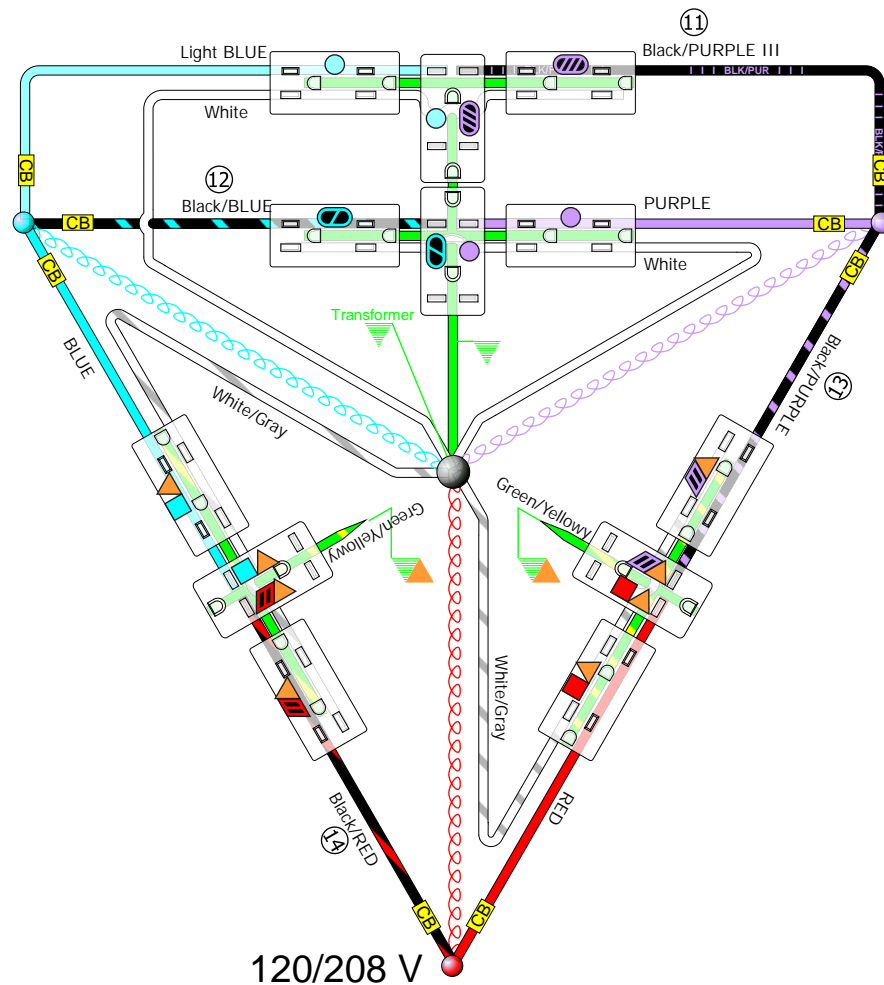

Phase selection illustrated provides maximum internal clearances, multiwire branch circuits, and pluggable 220 volt devices (use bi-pole breaker). To balance loads, add circuits or rearrange office equipment.

Transformer neutral grounding is mandatory. Black wires are represented by 3-phase color borders on duplex faces. Always common neutrals and grounds when lines are unused. Failure to do so may provide 240 volts to 120 volt equipment.

Risk of fire or electric shock. This office furnishings system may provide multiwire circuits supplied from alternate sources. Disconnect all sources prior to any servicing. No single circuit may be powered by more than one source.

